


# 2025 Annual

## Drinking Water

## Quality Report

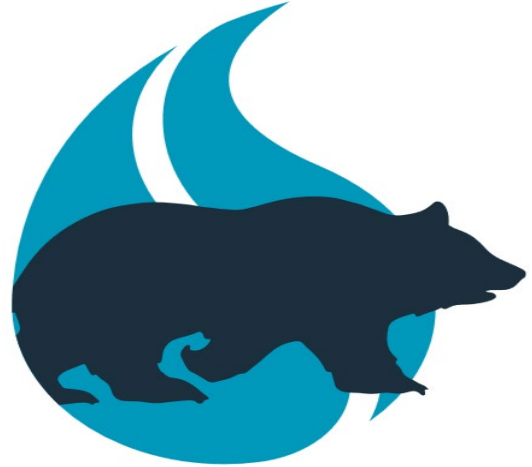

### Consumer Confidence Report Period January 1 to December 31, 2025

---

#### **BEAR CREEK SUD**

Phone No: 972-843-2101

**PWS ID# 0430037**

---

#### **SPECIAL NOTICE**

You may be more vulnerable than the general population to certain microbial contaminants, such as Cryptosporidium, in drinking water. Infants, some elderly or immunocompromised persons such as those undergoing chemotherapy for cancer; those who have undergone organ transplants; those who are undergoing treatment with steroids; and people with HIV/AIDS or other immune system disorders can be particularly at risk from infections. You should seek advice about drinking water from your physician or health care provider. Additional guidelines on appropriate means to lessen the risk of infection by Cryptosporidium and other microbial contaminants are available

from the Safe Drinking Water Hotline (1-800-426-4791).

#### **Public Participation Opportunities**

**Date:** 3rd Tuesday of each month

**Time:** 6:00 P.M.

**Location:** 16881 C. R. 541  
Lavon, TX 75166

**Phone No:** 972-843-2101

**Website:** [www.bearcreeksud.com](http://www.bearcreeksud.com)

If you have questions about this report or concerning your water utility, please contact Richard Nelson, General Manager, by calling (972) 843-2101 or writing to: P.O. Box 188, Lavon, TX 75166. You may also send an email to [h20@bearcreeksud.com](mailto:h20@bearcreeksud.com).

Este reporte incluye informacion importante sobre el agua para tomar. Para asistencia en español, favor de llamar al telefono (972) 843-2101.

## **Water Loss**

In the water loss audit submitted to the Texas Water Development Board for the time period of January – December 2024, our system lost an estimated 26,326,558 gallons of water. If you have any questions about the water loss, please call (972) 843-2101.

## **Sources of Drinking Water**

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals, and in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity. Contaminants that may be present in source water before treatment include:

Microbial contaminants, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.

Inorganic contaminants, such as salts and metals, which can be naturally-occurring or result from urban storm water runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.

Pesticides and herbicides, which may come from a variety of sources such as agriculture, urban storm water runoff, and residential uses.

Organic chemical contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and can also come from gas

stations, urban storm water runoff and septic systems.

Radioactive contaminants, which can be naturally-occurring or be the result of oil and gas production and mining activities.

## **Where do we get our drinking water?**

Bear Creek SUD purchases water from North Texas MWD (TX0430044) Wylie Water Treatment Plant. North Texas MWD Wylie Treatment Plant provides purchase surface water from Lake Lavon Reservoir located in Collin County. The meter from North Texas MWD Wylie Treatment Plant to Bear Creek SUD at take point 1 is a 3" meter and the meter at take point 2 is a 6" meter.

## **Source Water Assessment**

TCEQ completed a Source Water Susceptibility Assessment for all drinking water systems that own their sources. The report describes the susceptibility and types of constituents that may come in contact with your drinking water source based on human activities and natural conditions. The system(s) from which we purchase our water received the assessment report. For more information on source water assessments and protection efforts at our system, contact Richard Nelson, General Manager at (972) 843-2101.

For more information about your sources of water please refer to the Source Water Assessment Viewer available at <http://www.tceq.texas.gov/gis/swaview>. Further details about sources and source-water assessments are available in Drinking Water Watch at the following URL: <http://dww2.tceq.texas.gov/DWW/>.

**ALL drinking water may contain contaminants.**

When drinking water meets federal standards there may not be any health-based benefits to purchasing bottled water or point of use devices. Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the EPA's Safe Drinking Water Hotline (1-800-426-4791).

In order to ensure that tap water is safe to drink, EPA prescribes regulations which limit the amount of certain contaminants in water provided by public water systems. FDA regulations establish limits for contaminants in bottled water which must provide the same protection for public health.

### **Lead and Copper**

If present, elevated levels of lead can cause serious health problems, especially for pregnant women, infants (both formula-fed and breastfed), and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. The district is responsible for providing high quality drinking water but cannot control the variety of materials used in plumbing components. Because lead levels may vary over time, lead exposure is possible even when your tap sampling results do not detect lead at one point in time. You can help protect yourself and your family by identifying and removing lead materials within your home plumbing and taking steps to reduce your family's risk. Using a filter, certified by an American National Standards Institute accredited certifier to reduce lead, is effective in

reducing lead exposures. Follow the instructions provided with the filter to ensure the filter is used properly. Use only cold water for drinking, cooking, and making baby formula. Boiling water does not remove lead from water. Before using tap water for drinking, cooking, or making baby formula, flush your water for 30 seconds to 2 minutes. You can do this by running your tap, taking a shower, doing laundry or a load of dishes. If you have a lead service line or galvanized requiring replacement service line, you may need to flush your pipes for a longer period. If you are concerned about lead in your water, and wish to have your water tested, contact Bear Creek SUD at (972) 843-2101. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at <http://www.epa.gov/safewater/lead>.

### **Secondary Constituents**

Many constituents (such as calcium, sodium, or iron) which are often found in drinking water can cause taste, color, and odor problems. The taste and odor constituents are called secondary constituents and are regulated by the State of Texas, not the EPA. These constituents are not causes for health concern. Therefore, secondaries are not required to be reported in this document but they may greatly affect the appearance and taste of your water. For more information on taste, odor, or color of drinking water, please contact Bear Creek SUD at (972) 843-2101.

### **About the Following Section**

The section that follows list all of the federally regulated or monitored contaminants which have been found in your drinking water. The U. S. EPA requires water systems to test for up to 97 contaminants.

## Definitions

The following table contains scientific terms and measures, some of which may require explanation

### Action Level (AL)

The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

### Action Level Goal (ALG)

The level of a contaminant in drinking water below which there is no known or expected risk to health. ALGs allow for a margin of safety.

### Level 1 Assessment

A Level 1 assessment is a study of the water system to identify potential problems and determine (if possible) why total coliform bacteria have been found in our water system.

### Level 2 Assessment

A Level 2 assessment is a very detailed study of the water system to identify potential problems and determine (if possible) why an E. coli MCL violation has occurred and/or why total coliform bacteria have been found in our water system on multiple occasions.

### Maximum Contaminant Level (MCL)

The highest permissible level of a contaminant in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

### Maximum Contaminant Level Goal (MCLG)

The level of a contaminant in drinking water below which there is no known or expected health risk. MCLGs allow for a margin of safety.

### Maximum Residual Disinfectant Level (MRDL)

The highest level of disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

### Maximum Residual Disinfectant Level Goal (MRDLG)

The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contamination.

### Variances and Exemptions

State or EPA permission not to meet an MCL or a treatment technique under certain conditions.

**mrem:** millirems per year (a measure of radiation absorbed by the body).

**ppb:** micrograms per liter (ug/L) or parts per billion – or one ounce in 7,350,000 gallons of water.

**N/A:** not applicable.

**Avg:** Regulatory compliance with some MCLs are based on running annual average of monthly samples.

**RAA:** Running Annual Average

**LRAA:** Locational Running Annual Average

**ppm:** milligrams per liter (mg/L) or parts per million – or one ounce in 7,350 gallons of water.

**Treatment Technique (TT):** A required process intended to reduce the level of contaminant in drinking water

### ABBREVIATIONS

**NTU –** Nephelometric Turbidity Units (a measure of turbidity)

**MFL –** million fibers per liter (a measure of asbestos)

**pCi/L –** picocuries per liter (a measure of radioactivity)

**ppm -** parts per million, or milligrams per liter (mg/L)

**ppb -** parts per billion, or micrograms per liter (µg/L)

**ppt -** parts per trillion, or nanograms per liter (ng/L)

**ppq -** parts per quadrillion, or picograms per liter (pg/L)

**2025 Water Quality Results - Bear Creek Special Utility District**

**Coliform Bacteria**

Maximum Contaminant Level Goal	Total Coliform Maximum Contaminant Level	Highest No. of Positive	Fecal Coliform or E. Coli Maximum Contaminant Level	Positive E. Coli or Fecal Coliform	Violation	Likely Source of Contamination
0	1 positive monthly sample	2.00	0	0	No	Naturally present in the environment.

NOTE: Reported monthly tests found no fecal coliform bacteria. Coliforms are bacteria that are naturally present in the environment and are used as an indicator that other, potentially harmful bacteria may be present. Coliforms were found in more samples than allowed and this was a warning of potential problems. There are no additional required health effects violation notices. We found coliforms indicating the need to look for potential problems in water treatment or distribution. When this occurs, we are required to conduct assessment(s) to identify problems and to correct any problems that were found during these assessments.

During the past year we were required to conduct Level 1 assessment(s). 1 Level 1 assessment(s) were completed. In addition, we were required to take 0 corrective actions and we completed 0 of these actions.

**Regulated Contaminants**

Disinfection By-Products	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Total Haloacetic Acids (HAA5)	2025	25.2	6.50-25.20	No goal for the total	60	ppb	No	By-product of drinking water disinfection.
Total Trihalomethanes (TTHM)	2025	48.3	12.40-48.30	No goal for the total	80	ppb	No	By-product of drinking water disinfection.
Bromate	2025	Levels lower than detect level	0 - 0	5	10	ppb	No	By-product of drinking water ozonation.

NOTE: Not all sample results may have been used for calculating the Highest Level Detected because some results may be part of an evaluation to determine where compliance sampling should occur in the future. TCEQ only requires one sample annually for compliance testing. For Bromate, compliance is based on the running annual average.

**Maximum Residual Disinfectant Level**

Disinfectant Type	Year	Average Level of Quarterly Data	Lowest Result of Single Sample	Highest Result of Single Sample	MRDL	MRDLG	Units	Source of Chemical
Chlorine Residual (Chloramines)	2025	2.32	1.06	3.67	4.00	<4.0	ppm	Disinfectant used to control microbes.
Chlorine Dioxide	2025	0.050	0	0.63	0.80	0.80	ppm	Disinfectant.
Chlorite	2025	0.176	0	0.90	1.00	N/A	ppm	Disinfectant.

NOTE: Water providers are required to maintain a minimum chlorine disinfection residual level of 0.5 parts per million (ppm) for systems disinfecting with chloramines and an annual average chlorine disinfection residual level of between 0.5 ppm and 4 ppm.

**Lead and Copper**

Lead and Copper	Sampled	Action Level (AL)	90th Percentile	# Sites Over AL	Units	Violation	Likely Source of Contamination
Lead	2025	15	1.12	0	ppb	No	Corrosion of household plumbing systems; erosion of natural deposits.
Copper	2025	1.30	0.808	0	ppm	No	Erosion of natural deposits; leaching from wood preservatives; corrosion of household plumbing systems.

**LEAD AND COPPER RULE:** The Lead and Copper Rule protects public health by minimizing lead and copper levels in drinking water, primarily by reducing water corrosivity. Lead and Copper enter drinking water mainly from corrosion of plumbing materials containing lead and copper.

**ADDITIONAL HEALTH INFORMATION FOR LEAD:** If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. Bear Creek SUD is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at <http://www.epa.gov/safewater/lead>.

**Unregulated Contaminants**

Contaminants	Collection Date	Highest Level Detected	Range of Levels Detected	Units	Likely Source of Contamination
Chloroform	2025	13.4	6.85-13.40	ppb	By-product of drinking water disinfection.
Bromoform	2025	3.35	1.13-3.35	ppb	By-product of drinking water disinfection.
Bromodichloromethane	2025	18.5	7.98-18.50	ppb	By-product of drinking water disinfection.
Dibromochloromethane	2025	13.6	5.44-13.60	ppb	By-product of drinking water disinfection.

NOTE: Bromoform, chloroform, bromodichloromethane, and dibromochloromethane are disinfection by-products. There is no maximum contaminant level for these chemicals at the entry point to distribution. These contaminants are included in the Disinfection By-Products TTHM compliance data.

**Unregulated Contaminant Monitoring Rule (UCMR5)**

PWSs are required to report UCMR results in the CCR when unregulated contaminants are found (i.e., measured at or above minimum reporting levels [MRLs]), and must report the average and range of the monitoring results for the report year. Additionally, PWSs are required to notify customers through Tier 3 Public Notification (PN) about the availability of all UCMR results no later than 12 months after they are known by the PWS. If timing and delivery requirements are met, systems may include their PN within the CCR, also known as annual drinking water quality report. EPA has resources for PWSs available on the CCR and PN Compliance help webpages.

Contaminants	Collection	Average Level	Range of Levels	MRL	Units	Likely Source of Contamination
	2025	N/A	N/A		ppb	

## Lead Service Line Inventory

Bear Creek Special Utility District has completed its service line inventory and determined through filed investigations that no lead, galvanized requiring replacement, or lead status unknown service lines are in the system. To view and access the service line inventory, go to <https://bearcreeksud.com/all-forms-and-reports>, Related Documents, Lead and Copper Inventory 2024.

## NTMWD Wylie Water Treatment Plants Water Quality Data for Year 2025

### Regulated Contaminants

Inorganic Contaminants	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Antimony	2025	Levels lower than detect level	0 - 0	6	6	ppb	No	Discharge from petroleum refineries; fire retardants; ceramics; electronics; solder; and test addition.
Arsenic	2025	1	1 - 1	0	10	ppb	No	Erosion of natural deposits; runoff from orchards; runoff from glass and electronics production wastes.
Barium	2025	0.055	0.038 - 0.055	2	2	ppm	No	Discharge of drilling wastes; discharge from metal refineries; erosion of natural deposits.
Beryllium	2025	Levels lower than detect level	0 - 0	4	4	ppb	No	Discharge from metal refineries and coal-burning factories; discharge from electrical, aerospace, and defense industries.
Cadmium	2025	Levels lower than detect level	0 - 0	5	5	ppb	No	Corrosion of galvanized pipes; erosion of natural deposits; discharge from metal refineries; runoff from waste batteries and paints.
Chromium	2025	Levels lower than detect level	0 - 0	100	100	ppb	No	Discharge from steel and pulp mills; erosion of natural deposits.
Cyanide	2025	56.0	47.0 - 56.0	0 - 0	200	ppb	No	Discharge from steel/metal factories; Discharge from plastics and fertilizer factories.
Fluoride	2025	0.492	0.352 - 0.492	4	4	ppm	No	Erosion of natural deposits; water additive which promotes strong teeth; discharge from fertilizer and aluminum factories.
Mercury	2025	Levels lower than detect level	0 - 0	2	2	ppb	No	Erosion of natural deposits; discharge from refineries and factories; runoff from landfills; runoff from cropland.
Nitrate (measured as Nitrogen)	2025	0.866	0.082 - 0.866	10	10	ppm	No	Runoff from fertilizer use; leaching from septic tanks; sewage; erosion of natural deposits.
Selenium	2025	Levels lower than detect level	0 - 0	50	50	ppb	No	Discharge from petroleum and metal refineries; erosion of natural deposits; discharge from mines.
Thallium	2025	Levels lower than detect level	0 - 0	0.5	2	ppb	No	Discharge from electronics, glass, and leaching from ore-processing sites; drug factories.
<p><small>Nitrate Advisory: Nitrate in drinking water at levels above 10 ppm is a health risk for infants of less than six months of age. High nitrate levels in drinking water can cause blue baby syndrome. Nitrate levels may rise quickly for short periods of time because of rainfall or agricultural activity. If you are caring for an infant you should ask advice from your health care provider.</small></p>								
Radioactive Contaminants	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Beta/photon emitters	2024	5.3	5.3 - 5.3	0	50	pCi/L	No	Decay of natural and man-made deposits.
Gross alpha excluding radon and uranium	2024	Levels lower than detect level	0 - 0	0	15	pCi/L	No	Erosion of natural deposits.
Radium	2024	Levels lower than detect level	0 - 0	0	5	pCi/L	No	Erosion of natural deposits.

**NTMWD Wylie Water Treatment Plants  
Water Quality Data for Year 2025 (Cont.)**

Synthetic organic contaminants including pesticides and herbicides	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
2, 4, 5 - TP (Silvex)	2025	Levels lower than detect level	0 - 0	50	50	ppb	No	Residue of banned herbicide.
2, 4 - D	2025	Levels lower than detect level	0 - 0	70	70	ppb	No	Runoff from herbicide used on row crops.
Alachlor	2025	Levels lower than detect level	0 - 0	0	2	ppb	No	Runoff from herbicide used on row crops.
Aldicarb	2025	Levels lower than detect level	0 - 0	1	3	ppb	No	Runoff from agricultural pesticide.
Aldicarb Sulfone	2025	Levels lower than detect level	0 - 0	1	2	ppb	No	Runoff from agricultural pesticide.
Aldicarb Sulfoxide	2025	Levels lower than detect level	0 - 0	1	4	ppb	No	Runoff from agricultural pesticide.
Atrazine	2025	0.1	0.1 - 0.1	3	3	ppb	No	Runoff from herbicide used on row crops.
Benzo (a) pyrene	2025	Levels lower than detect level	0 - 0	0	200	ppt	No	Leaching from linings of water storage tanks and distribution lines.
Carbofuran	2025	Levels lower than detect level	0 - 0	40	40	ppb	No	Leaching of soil fumigant used on rice and alfalfa.
Chlordane	2025	Levels lower than detect level	0 - 0	0	2	ppb	No	Residue of banned termiticide.
Dalapon	2025	Levels lower than detect level	0 - 0	200	200	ppb	No	Runoff from herbicide used on rights of way.
Di (2-ethylhexyl) adipate	2025	Levels lower than detect level	0 - 0	400	400	ppb	No	Discharge from chemical factories.
Di (2-ethylhexyl) phthalate	2025	Levels lower than detect level	0 - 0	0	6	ppb	No	Discharge from rubber and chemical factories.
Dibromochloropropane (DBCP)	2025	Levels lower than detect level	0 - 0	0	200	ppt	No	Runoff / leaching from soil fumigant used on soybeans, cotton, pineapples, and orchards.
Dinoseb	2025	Levels lower than detect level	0 - 0	7	7	ppb	No	Runoff from herbicide used on soybeans and vegetables.
Endrin	2025	Levels lower than detect level	0 - 0	2	2	ppb	No	Residue of banned insecticide.
Ethylene dibromide	2025	Levels lower than detect level	0 - 0	0	50	ppt	No	Discharge from petroleum refineries.
Heptachlor	2025	Levels lower than detect level	0 - 0	0	400	ppt	No	Residue of banned termiticide.
Heptachlor epoxide	2025	Levels lower than detect level	0 - 0	0	200	ppt	No	Breakdown of heptachlor.
Hexachlorobenzene	2025	Levels lower than detect level	0 - 0	0	1	ppb	No	Discharge from metal refineries and agricultural chemical factories.
Hexachlorocyclopentadiene	2025	Levels lower than detect level	0 - 0	50	50	ppb	No	Discharge from chemical factories.
Lindane	2025	Levels lower than detect level	0 - 0	200	200	ppt	No	Runoff / leaching from insecticide used on cattle, lumber, and gardens.
Methoxychlor	2025	Levels lower than detect level	0 - 0	40	40	ppb	No	Runoff / leaching from insecticide used on fruits, vegetables, alfalfa, and livestock.
Oxamyl [Vydate]	2025	Levels lower than detect level	0 - 0	200	200	ppb	No	Runoff / leaching from insecticide used on apples, potatoes, and tomatoes.
Pentachlorophenol	2025	Levels lower than detect level	0 - 0	0	1	ppb	No	Discharge from wood preserving factories.
Picloram	2025	Levels lower than detect level	0 - 0	500	500	ppb	No	Herbicide runoff.
Simazine	2025	Levels lower than detect level	0 - 0	4	4	ppb	No	Herbicide runoff.
Toxaphene	2025	Levels lower than detect level	0 - 0	0	3	ppb	No	Runoff / leaching from insecticide used on cotton and cattle.
Volatile Organic Contaminants	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
1, 1, 1 - Trichloroethane	2025	Levels lower than detect level	0 - 0	200	200	ppb	No	Discharge from metal degreasing sites and other factories.
1, 1, 2 - Trichloroethane	2025	Levels lower than detect level	0 - 0	3	5	ppb	No	Discharge from industrial chemical factories.
1, 1 - Dichloroethylene	2025	Levels lower than detect level	0 - 0	7	7	ppb	No	Discharge from industrial chemical factories.
1, 2, 4 - Trichlorobenzene	2025	Levels lower than detect level	0 - 0	70	70	ppb	No	Discharge from textile-finishing factories.
1, 2 - Dichloroethane	2025	Levels lower than detect level	0 - 0	0	5	ppb	No	Discharge from industrial chemical factories.
1, 2 - Dichloropropane	2025	Levels lower than detect level	0 - 0	0	5	ppb	No	Discharge from industrial chemical factories.
Benzene	2025	Levels lower than detect level	0 - 0	0	5	ppb	No	Discharge from factories; leaching from gas storage tanks and landfills.
Carbon Tetrachloride	2025	Levels lower than detect level	0 - 0	0	5	ppb	No	Discharge from chemical plants and other industrial activities.

## NTMWD Wylie Water Treatment Plants Water Quality Data for Year 2025 (Cont.)

Volatile Organic Contaminants	Collection Date	Highest Level Detected	Range of Levels Detected	MCLG	MCL	Units	Violation	Likely Source of Contamination
Chlorobenzene	2025	Levels lower than detect level	0 - 0	100	100	ppb	No	Discharge from chemical and agricultural chemical factories.
Dichloromethane	2025	Levels lower than detect level	0 - 0	0	5	ppb	No	Discharge from pharmaceutical and chemical factories.
Ethylbenzene	2025	Levels lower than detect level	0 - 0	0	700	ppb	No	Discharge from petroleum refineries.
Styrene	2025	Levels lower than detect level	0 - 0	100	100	ppb	No	Discharge from rubber and plastic factories; leaching from landfills.
Tetrachloroethylene	2025	Levels lower than detect level	0 - 0	0	5	ppb	No	Discharge from factories and dry cleaners.
Toluene	2025	Levels lower than detect level	0 - 0	1	1	ppm	No	Discharge from petroleum factories.
Trichloroethylene	2025	Levels lower than detect level	0 - 0	0	5	ppb	No	Discharge from metal degreasing sites and other factories.
Vinyl Chloride	2025	Levels lower than detect level	0 - 0	0	2	ppb	No	Leaching from PVC piping; discharge from plastics factories.
Xylenes	2025	Levels lower than detect level	0 - 0	10	10	ppm	No	Discharge from petroleum factories; discharge from chemical factories.
cis - 1, 2 - Dichloroethylene	2025	Levels lower than detect level	0 - 0	70	70	ppb	No	Discharge from industrial chemical factories.
o - Dichlorobenzene	2025	Levels lower than detect level	0 - 0	600	600	ppb	No	Discharge from industrial chemical factories.
p - Dichlorobenzene	2025	Levels lower than detect level	0 - 0	75	75	ppb	No	Discharge from industrial chemical factories.
trans - 1, 2 - Dichloroethylene	2025	Levels lower than detect level	0 - 0	100	100	ppb	No	Discharge from industrial chemical factories.

### Turbidity

	Limit (Treatment Technique)	Level Detected	Violation	Likely Source of Contamination
Highest single measurement	1 NTU	0.29	No	Soil runoff.
Lowest monthly percentage (%) meeting limit	0.3 NTU	100%	No	Soil runoff.

**NOTE:** Turbidity is a measurement of the cloudiness of the water caused by suspended particles. We monitor it because it is a good indicator of water quality and the effectiveness of our filtration.

### Total Organic Carbon

The percentage of Total Organic Carbon (TOC) removal was measured each month and the system met all TOC removal requirements set.

### Cryptosporidium and Giardia

Contaminants	Collection Date	Highest Level Detected	Range of Levels Detected	Units	Likely Source of Contamination
Cryptosporidium	2025	Levels lower than detect level	0 - 0	(Oo) Cysts/L	Human and animal fecal waste. Naturally present in the environment.
Giardia	2025	Levels lower than detect level	0 - 0	(Oo) Cysts/L	Human and animal fecal waste. Naturally present in the environment.

**NOTE:** Levels detected are for source water, not for drinking water. No cryptosporidium or giardia were found in drinking water.

## NTMWD Wylie Water Treatment Plants Water Quality Data for Year 2025 (Cont.)

### Secondary and Other Constituents Not Regulated

Contaminants	Collection Date	Highest Level Detected	Range of Levels Detected	Units	Likely Source of Contamination
Aluminum	2025	Levels lower than detect level	0 - 0	ppm	Erosion of natural deposits.
Calcium	2025	61.3	31.2 - 61.3	ppm	Abundant naturally occurring element.
Chloride	2025	92.5	29.0 - 92.5	ppm	Abundant naturally occurring element; used in water purification; by-product of oil field activity.
Iron	2025	Levels lower than detect level	0 - 0	ppm	Erosion of natural deposits; iron or steel water delivery equipment or facilities.
Magnesium	2025	9.44	6.27 - 9.44	ppm	Abundant naturally occurring element.
Manganese	2025	0.002	0.002 - 0.002	ppm	Abundant naturally occurring element.
Nickel	2025	0.007	0.005 - 0.007	ppm	Erosion of natural deposits.
pH	2025	8.8	7.3 - 8.8	units	Measure of corrosivity of water.
Silver	2025	Levels lower than detect level	0 - 0	ppm	Erosion of natural deposits.
Sodium	2025	88.0	41.9 - 88.0	ppm	Erosion of natural deposits; by-product of oil field activity.
Sulfate	2025	147	84.7 - 147	ppm	Naturally occurring; common industrial by-product; by-product of oil field activity.
Total Alkalinity as CaCO3	2025	138	43.6 - 138	ppm	Naturally occurring soluble mineral salts.
Total Dissolved Solids	2025	455	182 - 455	ppm	Total dissolved mineral constituents in water.
Total Hardness as CaCO3	2025	200	96.0 - 200	ppm	Naturally occurring calcium.
Zinc	2025	0.016	0.006 - 0.016	ppm	Moderately abundant naturally occurring element used in the metal industry.

### Violations Table

Violation Type	Violation Begin	Violation End	Violation Explanation

### Lead Service Line Inventory

North Texas Municipal Water District has completed its service line inventory and determined through field investigations that no lead, galvanized requiring replacement, or lead status unknown service lines are in the system. To view and access the service line inventory, go to <https://www.ntmwd.com/200/Water-Quality>.